
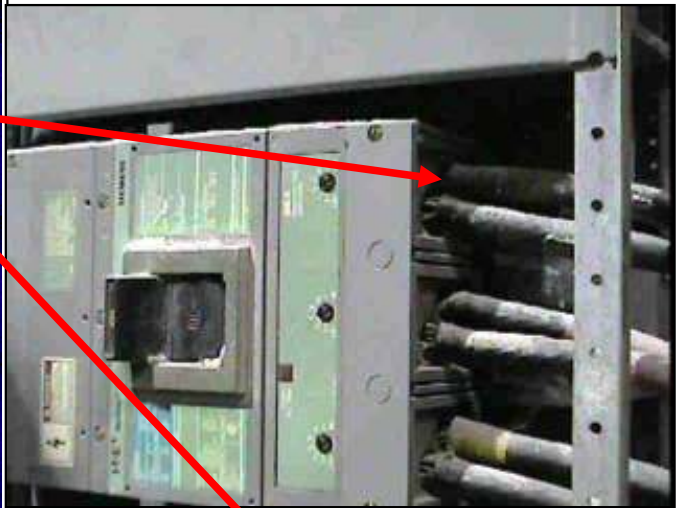


IR Scan Results

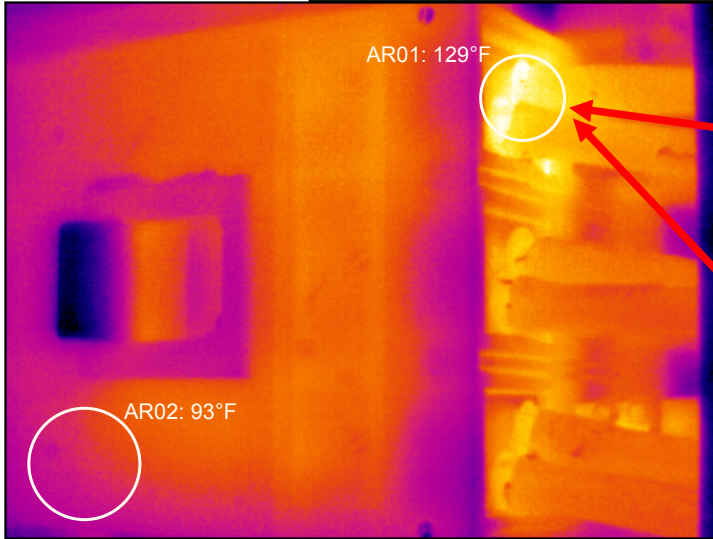

These images were taken on **10/14/2005** at **9:06:43 AM**

File Name | Ir_0112.jpg

<u>Infrared Image Information</u>	Ambient Temperature -
Temperature Rise (AR01 - AR02)	23.9 °F
Reference Temperature (AR02)	105°F
Point of Concern Temp. (AR01)	129°F

<u>Infrared Image Information</u>	
Location	Plant Main #1
Problem	Heating connection / 6000 switch gear
Severity	Critical
Comment's	None needed

For electrical equipment of this importance a 23.9 degrees anomaly is a very serious issue

<u>IR Technician Information</u>			
IR Technician	Olen C. Sawyer	Certification #	Level II # 12514
Phone Number	Toll Free 1-866-412-2368		Cell 828-230-0314