
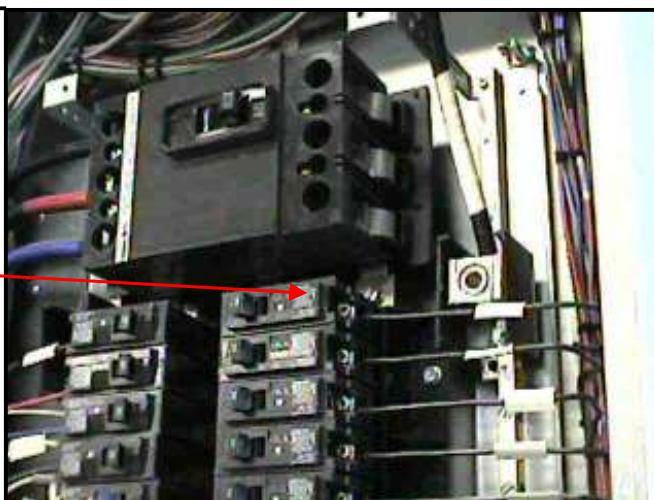


IR Scan Results

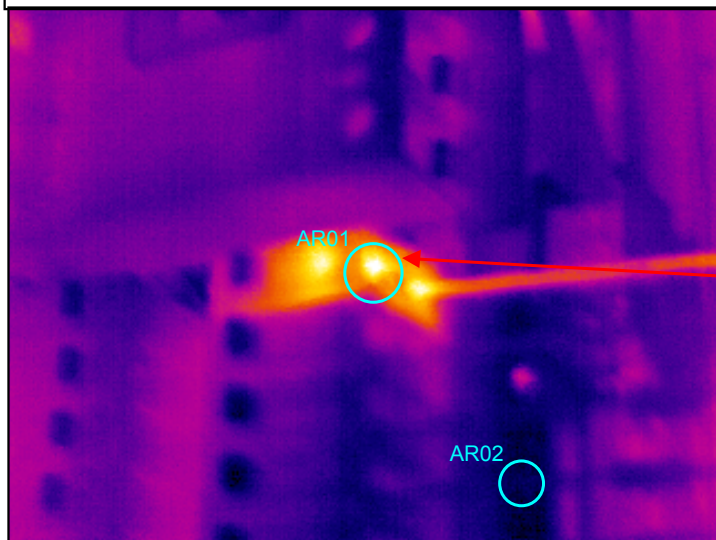

These images were taken on 10/11/2005 at 8:20:44 AM

File Name	*
-----------	---

IR Information

Temperature Rise	14.6 °F	Condition	Minor
Reference Temperature	66.5°F		
Point of Concern Temp.	81.7°F		

Location/Equipment Information

Equipment	Panel Breaker
Point of Concern	Electrical room
Location of Point of Concern	Panel RP4
Reference Address	

Minor problems can sometimes become hugh if undetected and failure occurs

IR Technician Information

IR Technician	Olen C. Sawyer Johnny Jordan	Certification #	Level II # 12514
Phone Number	1-866-412-2368 Cell 828-230-0314		