
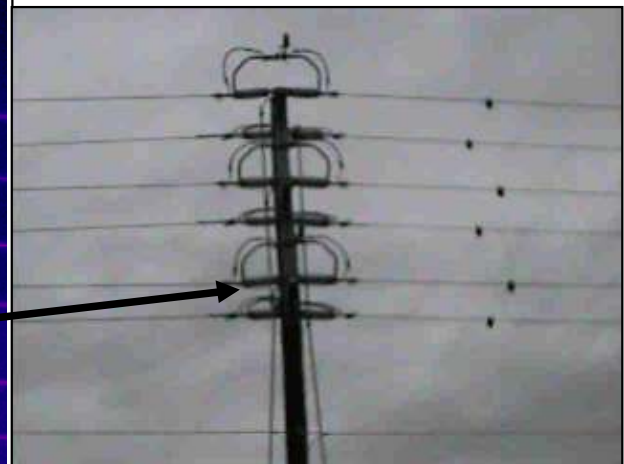


IR Scan Results

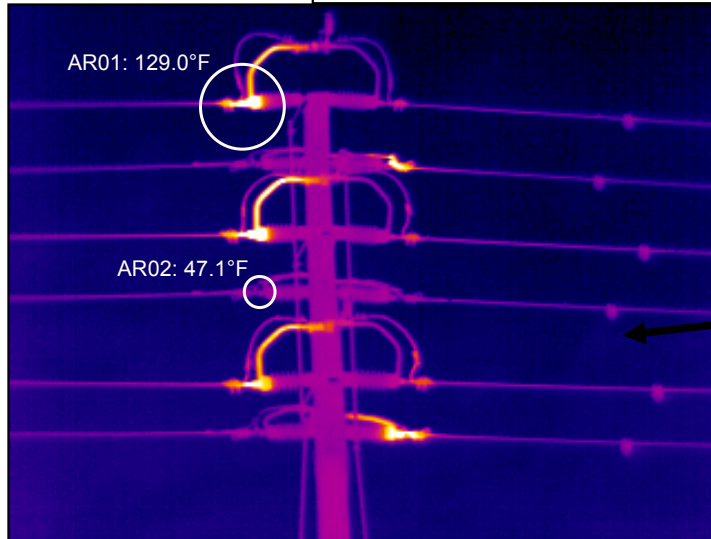

These images were taken on **1/23/2005** at **1:54:46 PM**

File Name	lr_0146.jpg
-----------	-------------

<u>Infrared Image Information</u>	Ambient Temperature -
Temperature Rise (AR01 - AR02)	74.5 °F
Reference Temperature (AR02)	54.5°F
Point of Concern Temp. (AR01)	129.0°F

<u>Infrared Image Information</u>	
Location	2
Problem	Air Break switch connections failing
Severity	Critical
Comment's	

Unexpected failure of this type equipment can be devastating to Hospitals , Manufacturing processes or critical customers

<u>IR Technician Information</u>			
IR Technician	Olen C. Sawyer	Certification #	Level II # 12514
Phone Number	Toll Free 1-866-412-2368	Cell 828-230-0314	